




Unique Fire Stop Products

UL XHEZ.W-L-3230 Drywall 1 and 2 Hr. Through-Firestop System using Unique Fire Stop Products – Membrane Firestop

UL Guide XHEZ
Through-Firestop Systems

April 12, 2010

System No. W-L-3230
F Rating - 1 and 2 Hr (See Item 1)
T Rating - 1/4 Hr

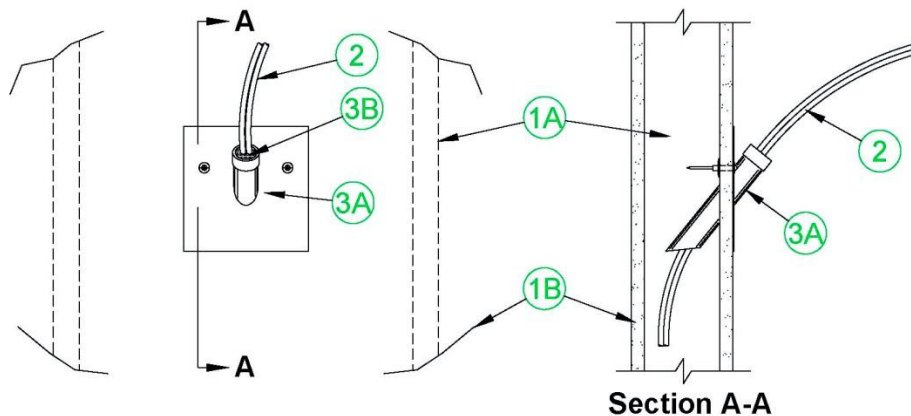

1. **Wall Assembly** — The 1 or 2 hr fire-rated gypsum board/stud wall assembly shall be constructed of the materials and in the manner described in the individual U300, U400 or V400 Series Wall and Partition Designs in the UL Fire Resistance Directory and shall include the following construction features:

A. **Studs** — Wall framing shall consist of either wood studs or steel channel studs. Wood studs to consist of nom 2 by 4 in. (51 by 102 mm) lumber spaced max 16 in. (406 mm) OC. Steel studs to be min 3-1/2 in. (89 mm) wide and spaced max 24 in. (610 mm) OC.

B. **Gypsum Board*** — 5/8 in. (16 mm) thick, 4 ft (1219 mm) wide with square or tapered edges. The gypsum board type, thickness, number of layers, fastener type and sheet orientation shall be as specified in the individual U300 or U400 Series Designs in the UL Fire Resistance Directory.

The hourly F Rating of the firestop system is equal to the hourly fire rating of the wall assembly in which it is installed.

2. **Cables** — Aggregate cross-sectional area of cables in membrane firestop (Item 3A) not to exceed 0.4 sq in. (258 mm sq.). Cables to be rigidly supported within 24 in. (610 mm) of wall assembly. Any combination of the following types and sizes of cables may be used:

- A. Max 100 pair No. 24 AWG (or smaller) copper conductor cable with polyvinyl chloride (PVC) jacketing and insulation.
- B. Max RG59/U (or smaller) coaxial cable with fluorinated ethylene insulation and jacketing.
- C. Max 62.5/48 fiber optic cable with PVC insulation and jacketing.
- D. Max 4 pair No. 24 AWG (or smaller) copper conductor Category 5 data cable with Hylar insulation and jacket.

3. **Firestop System** — The firestop system shall consist of the following:

A. **Firestop Device*** — Nom 1 in. (25 mm) diam angled steel conduit in a steel mounting plate provided with plastic tipped molly bolts and a plastic bushing. Device shall be driven through gypsum board and secured to wall assembly in accordance with the accompanying installation instructions.

UNIQUE FIRE STOP PRODUCTS INC — Membrane Firestop

B. **Fill, Void or Cavity Material* - Putty** — Nom 1/4 in. (6 mm) diam continuous bead applied to form gasket between back of firestop device mounting plate and wall surface around perimeter of conduit prior to installation of molly bolts. Min 1 in. thickness of fill material applied within the steel conduit device, flush with end protruding from wall. Allowable fill materials: Hilti CP 618 Putty / Specified Technologies Inc. Spec Seal Putty / Rectorseal Metacaulk

HILTI INC - CP 618

RECTORSEAL - FSP 1000 Putty. F rating is 2 Hr when this material is used.

STI- SSP series

* Bearing the UL Classification Mark

Design/System/Construction/Assembly Usage Disclaimer

- Authorities Having Jurisdiction should be consulted in all cases as to the particular requirements covering the installation and use of UL Listed or Classified products, equipment, system, devices, and materials.
- Authorities Having Jurisdiction should be consulted before construction.
- Fire resistance assemblies and products are developed by the design submitter and have been investigated by UL for compliance with applicable requirements. The published information cannot always address every construction nuance encountered in the field.
- When field issues arise, it is recommended the first contact for assistance be the technical service staff provided by the product manufacturer noted for the design. Users of fire resistance assemblies are advised to consult the general Guide Information for each product category and each group of assemblies. The Guide Information includes specifics concerning alternate materials and alternate methods of construction.
- Only Products which bear UL's Mark are considered as Classified, Listed, or Recognized.

Reprinted from the UL Online Certification Directory with permission from Underwriters Laboratories Inc.

Copyright © 2011 Underwriters Laboratories Inc. ®

Last Update: 2011-06-22